

ETA-Danmark A/S Göteborg Plads 1 DK-2150 Nordhavn Tel. +45 72 24 59 00 Internet <u>www.etadanmark.dk</u> Authorised and notified according to Article 29 of the Regulation (EU) No 305/2011 of the European Parliament and of the Council of 9 March 2011



European Technical Assessment ETA-20/1151 of 2020/12/20

I General Part

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: ETA-Danmark A/S

Trade name of the construction product:	PFC Corofil Intumescent pipe collar
Product family to which the above construction product belongs:	Fire Stopping, Fire Sealing & Fire Protective Products. Fire Retardant Products
Manufacturer:	PFC Corofil Ltd Unit 3&4 King George Trading Estate Davis Road Chessington KT9 1TT Great Britain Telephone: +44 20 8391 0533 www.pfc-corofil.com
Manufacturing plant:	PFC Corofil Ltd Manufacturing Plant II
This European Technical Assessment contains:	18 pages including 1 annex which form an integral part of the document
This European Technical Assessment is issued in accordance with Regulation (EU) No 305/2011, on the basis of:	EAD 350454-00-1104 Firestopping and fire sealing products, Penetration Seals, Issued September 2017
This version replaces:	-

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full [except the confidential Annex(es) referred to above]. However, partial reproduction may be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

1 Technical Description of the Product

- 1) PFC Corofil Intumescent pipe collar is installed round combustible pipes to form a penetration seal used to reinstate the fire resistance performance of wall and floor constructions, where they have been provided with apertures for the penetration of combustible pipe services.
- 2) PFC Corofil Intumescent pipe collar include an intumescent component incorporated into a mild steel case to close any gaps and joints and provide a closure of combustible pipes when heated and to prevent the passage of fire.
- 3) PFC Corofil Intumescent pipe collar are supplied in assembled form, without fixings. The collar is wrapped around the pipe at the soffit or both faces of walls, depending on application. Fixing specifications are detailed in Annex A.
- 4) PFC Corofil Intumescent pipe collar can be used with PFC Corofil Acoustic intumescent sealant to seal the space between the combustible pipe and the aperture to close gap sizes as specified in Annex A.

2 Specification of the intended use(s) in accordance with the applicable European Assessment Document (hereinafter EAD)

The intended use of PFC Corofil Intumescent pipe collar is to reinstate the fire resistance performance of rigid and flexible The intended use of PFC Corofil Intumescent pipe collar is to reinstate the fire resistance performance of wall and floor constructions, where they are penetrated by various combustible pipe services.

The specific elements of construction that the system PFC Corofil Intumescent pipe collar may be used is as follows:

- Flexible walls: The wall must have a minimum thickness of 100 mm and comprise timber or steel studs line on both faces with minimum 2 layers of 12.5 mm thick, 'Type F' Gypsum boards according to EN 520. In timber stud walls, no part of the penetration seal shall be closer than 100mm to a stud, and minimum 100 mm of insulation of class A1 or A2 according to EN 13501-1, is provided within the cavity between the penetration seal and the stud.
- Rigid walls: The wall must have a minimum thickness of 100 mm and comprise of concrete, aerated concrete or masonry, with a minimum density of 650 km/m³.
- Rigid floor: The floor must have a minimum thickness of 150 mm and comprise of concrete, aerated concrete or masonry, with a minimum density of 650 km/m³.
- 1) The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.
- 2) The system PFC Corofil Intumescent pipe collar may be used to provide a penetration seal with specific combustible pipes, single only (for details see Annex A).
- 3) Apertures in the separating element shall be maximum 10 mm diameter oversize with respect to the pipe diameter. The remaining annular space/gap shall be infilled with PFC Corofil Intumescent pipe collar . Apertures for the penetration of pipes shall be separated by a minimum of 200 mm.

- 4) The provisions made in this European Technical Assessment are based on an assumed working life of the PFC Corofil Intumescent pipe collar of 10 years, The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.
- 5) Services in walls shall be supported at maximum 400mm from the face of the separating element for walls, and 400mm above the surface of the floor.

Use Category

Type X: Intended for use in conditions exposed to weathering.

3 Performance of The Product And References To The Methods Used For Its Assessment

Characteristic	Assessment of characteristic				
BWR 2 Safety in case of fire					
Reaction to fire	See clause 1.1				
Resistance to fire See clause 1.2					
BWR 3 Hygiene, Health and the Environment					
Release of dangerous substances	See clause 2.1				
BWR 4 Safety in use					
Durability and serviceability	See clause 3.1				
BWR 5 Protection against nois	se				
BWR 6 Energy, Economy and Heat R	etention				
BWR 7 Sustainable use of natural resources					

3.1 Safety in case of fire

3.1.1 Reaction to fire

PFC Corofil Intumescent pipe collar classified ${\bf E}$ in accordance with EN 13501-1

3.1.2 Resistance to fire

See Annex A

3.2 Hygiene, Health and the Environment.

3.2.1 Release of dangerous substance

Category IA1, S/W3 Declaration of manufacturer

The applicant have presented a declaration that PFC Corofil Intumescent pipe collar release no dangerous substances in compliance with Council Directive 67/548/EEC of 1st June 2015 on the approximation of the laws, regulations and administrative provisions of the Member States relating to restrictions on the marketing and use of certain dangerous substances and preparations (incl. All amendments and adaptations).

The manufacturer declares that the product contains no dangerous substances according to current European and National regulations.

The applicant has submitted a written declaration that the product and/or constituents of the product contains no substances which have been classified as dangerous according to Directive 67/548/EEC and Regulation (EC) No. 1272/2008 and listed in the 'indicative list on dangerous substances' of the EGDS – taking into account the installation conditions of the construction product and the release scenarios resulting from there.

In addition to the specific clauses relating to dangerous substances contained in this European Technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

The use catagory of PFC Corofil Intumescent pipe collar in relation to BWR 3 (Hygiene, health and environment) is IA1, S/W3.

In addition to the specific clauses relating to dangerous substances contained in this European technical approval, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations, and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

3.3 Safety and accessibility in use

3.3.1 Durability

PFC Corofil Intumescent pipe collar has been tested in accordance with EOTA Technical Report - TR024 – Edition November 2006, Fire Stopping and Fire Sealing Products-Penetration Seals for the type X, environmental conditions: Products for penetration seals intended for outdoor use exposed to weathering – rain, UV, high temperatures, frost and frost-thaw in winter.

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

According to the decision 1999/454/EC of the European Commission the system of assessment and verification of constancy of performance (see Annex V to the Regulation (EU) No 305/2011) given in the following table apply:

Products	Intended use/s	AVCP System
Fire stopping and fire sealing products	For fire compartmentation and / or fire protection or fire performance	System 1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited at ETA-Danmark A/S prior to CE marking

Issued in Copenhagen on 2020-12-20 by

Thomas Bruun Managing Director, ETA-Danmark


Annex A

Resistance to Fire Classification of PFC Corofil Intumescent pipe collar

A.1 Floor construction with thickness of minimum 150 mm

A.1.1 Penetration seal with PFC Corofil Intumescent pipe collar installed on the underside of rigid floor

Construction details: Combustible pipes installed with a single PFC Corofil Intumescent pipe collar to the underside. Maximum 10 mm annular space filled with PFC Corofil Acoustic intumescent sealant.

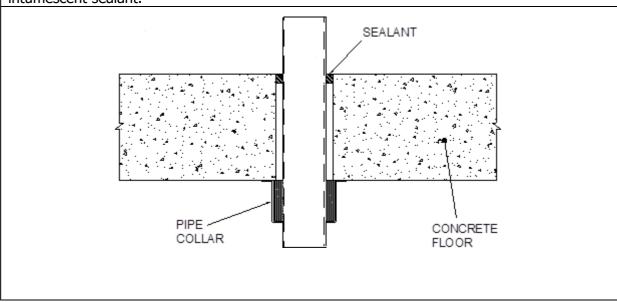

A.1.1.1 PVC-U pipes with PFC Corofil Intumescent pipe collar installed on the underside of rigid floor

PVC-U pipes according to EN 1452 with PFC Corofil Intumescent pipe collar.

PFC	C Corofil Intumesce	nt pipe collar, Face Fi (min 150 mm thick)		derside of Rigid Floo	r
Penetration Specification	Collar Reference	Intumescent Material	Annulus Space (mm)	Collar Fixing	Classification
PVC Pipe 32 mm ø 1.8 mm wall thickness	32 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 4 mm			
PVC Pipe 40 mm ø 1.8 mm wall thickness	40 mm PFC Corofil Intumescent pipe collar	(T)			
PVC Pipe 50 mm ø 1.8 mm wall thickness	50 mm PFC Corofil Intumescent pipe collar				
PVC Pipe 55 mm ø 2.3- 3.0 mm wall thickness	55 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 6 mm (T)	10	Face fixed on the underside of rigid floor with 3No.	EI 240 U/C
PVC Pipe 63 mm ø 2.3- 3.0 mm wall thickness	63 mm PFC Corofil Intumescent pipe collar			Fischer FSA Ø8 x 60mm long, with M6 hexagon head bolts	
PVC Pipe 75 mm ø 3.1- 4.8 mm wall thickness	75 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 8 mm (T)			
PVC Pipe 82 mm ø 3.1- 4.8 mm wall thickness	82 mm PFC Corofil Intumescent pipe collar				
PVC Pipe 90 mm ø 4.2- 7.4 mm wall thickness	90 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 10 mm			
PVC Pipe 100 mm ø 4.2- 7.4 mm wall thickness	100 mm PFC Corofil Intumescent pipe collar	(T)			
PVC Pipe 110 mm ø 4.2- 7.4 mm wall thickness	110 mm PFC Corofil Intumescent pipe collar				
PVC Pipe 125 mm ø 6.0 mm wall thickness	125 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 12 mm (T)			
PVC Pipe 140 mm ø 6.1- 7.5 mm wall thickness	140 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 16 mm (T)			
PVC Pipe 160 mm ø 6.2- 9.5 mm wall thickness	160 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 18 mm (T)			

A.1.1.2 PP pipes with PFC Corofil Intumescent pipe collar installed on the underside of rigid floor

PP pipes according to EN 1451 with PFC Corofil Intumescent pipe collar.

PFC	PFC Corofil Intumescent pipe collar, Face Fixed on the Underside of Rigid Floor (min 150 mm thick) PP Pipes					
Penetration Specification	Collar Reference	Intumescent Material	Annulus Space (mm)	Collar Fixing	Classification	
PP Pipe 32 mm ø 2.9 mm wall thickness	32 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 4 mm				
PP Pipe 40 mm ø 2.9 mm wall thickness	40 mm PFC Corofil Intumescent pipe collar	(T)				
PP Pipe 50 mm ø 2.9 mm wall thickness	50 mm PFC Corofil Intumescent pipe collar					
PP Pipe 55 mm ø 2.9- 4.4 mm wall thickness	55 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 6 mm (T)	10	Face fixed on the underside of rigid	51 340 W/C	
PP Pipe 63 mm ø 2.9- 4.4 mm wall thickness	63 mm PFC Corofil Intumescent pipe collar		10	floor with 3No. Fischer FSA Ø8 x 60mm long, with M6 hexagon head bolts	EI 240 U/C	
PP Pipe 75 mm ø 2.8- 6.7 mm wall thickness	75 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 8 mm (T)				
PP Pipe 82 mm ø 2.8- 6.7 mm wall thickness	82 mm PFC Corofil Intumescent pipe collar					
PP Pipe 90 mm ø 2.7- 10.0 mm wall thickness	90 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 10 mm				
PP Pipe 100 mm ø 2.7- 10.0 mm wall thickness	100 mm PFC Corofil Intumescent pipe collar	(T)				
PP Pipe 110 mm ø 2.7- 10.0 mm wall thickness	110 mm PFC Corofil Intumescent pipe collar					
PP Pipe 125 mm ø 3.1 mm wall thickness	125 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 12 mm (T)				
PP Pipe 140 mm ø 3.5- 8.0 mm wall thickness	140 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 16 mm (T)				
PP Pipe 160 mm ø 4.0- 14.6 mm wall thickness	160 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 18 mm (T)				


A1.1.3 PE pipes with PFC Corofil Intumescent pipe collar installed on the underside of rigid floor

PE pipes according to EN ISO 15494 with PFC Corofil Intumescent pipe collar.

PFC Corofil Intumescent pipe collar, Face Fixed on the Underside of Rigid Floor (min 150 mm thick) PE Pipes					
Penetration Specification	Collar Reference	Intumescent Material	Annulus Space (mm)	Collar Fixing	Classification
PE Pipe 32 mm ø 2.9 mm wall thickness	32 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 4 mm			
PE Pipe 40 mm ø 2.9 mm wall thickness	40 mm PFC Corofil Intumescent pipe collar	(T)			
PE Pipe 50 mm ø 2.9 mm wall thickness	50 mm PFC Corofil Intumescent pipe collar				
PE Pipe 55 mm ø 2.9- 4.4 mm wall thickness	55 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 6 mm (T)	10	Face fixed on the underside of rigid floor with 3No.	EI 240 U/C
PE Pipe 63 mm ø 2.9- 4.4 mm wall thickness	63 mm PFC Corofil Intumescent pipe collar	C Corofil ent pipe	10	Fischer FSA Ø8 x 60mm long, with M6 hexagon head bolts	LI 240 0/C
PE Pipe 75 mm ø 2.8- 6.7 mm wall thickness	75 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 8 mm (T)			
PE Pipe 82 mm ø 2.8- 6.7 mm wall thickness	82 mm PFC Corofil Intumescent pipe collar				
PE Pipe 90 mm ø 2.7- 10.0 mm wall thickness	90 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 10 mm			
PE Pipe 100 mm ø 2.7- 10.0 mm wall thickness	100 mm PFC Corofil Intumescent pipe collar	(T)			
PE Pipe 110 mm ø 2.7- 10.0 mm wall thickness	110 mm PFC Corofil Intumescent pipe collar				
PE Pipe 125 mm ø 3.1 mm wall thickness	125 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 12 mm (T)			
PE Pipe 140 mm ø 3.9- 5.8 mm wall thickness	140 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 16 mm (T)			
PE Pipe 160 mm ø 4.9- 9.5 mm wall thickness	160 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 18 mm (T)			

A.1.2 Penetration seal with PFC Corofil Intumescent pipe collar installed on both sides of rigid floor

Construction details: Combustible pipes installed with a single PFC Corofil Intumescent pipe collar to both sides. Maximum 10 mm annular space filled with PFC Corofil Acoustic intumescent sealant.

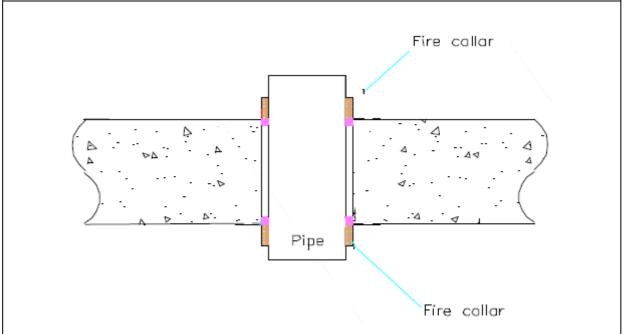

A.1.2.1 Penetration seal with PFC Corofil Intumescent pipe collar installed on both sides of rigid floor


PP pipes according to EN 1451 with PFC Corofil Intumescent pipe collar.

PFC Corofil Intumescent pipe collar, Face Fixed on Both Sides of Rigid Floor (min 150 mm thick) PP Pipes						
Penetration Specification	Collar Reference	Intumescent Material	Annulus Space (mm)	Collar Fixing	Classificati on	
PP Pipe 110 mm ø 2.7 mm wall thickness	110 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 10 mm (T)	10	Fixed on both faces of rigid floor with 3No. Fischer FSA Ø8	EI 120 U/U	
PP Pipe 160 mm ø 4.0 mm wall thickness	160 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 16 mm (T)		x 60mm long, with M6 hexagon head bolts	EI 120 C/U	

A.2 Wall construction with thickness of minimum 100 mm

A.2.1 Penetration seal with PFC Corofil Intumescent pipe collar installed on both sides of flexible or rigid wall

Construction details: Combustible pipes installed with a single PFC Corofil Intumescent pipe collar to both sides. Maximum 10 mm annular space filled with PFC Corofil Acoustic intumescent sealant.

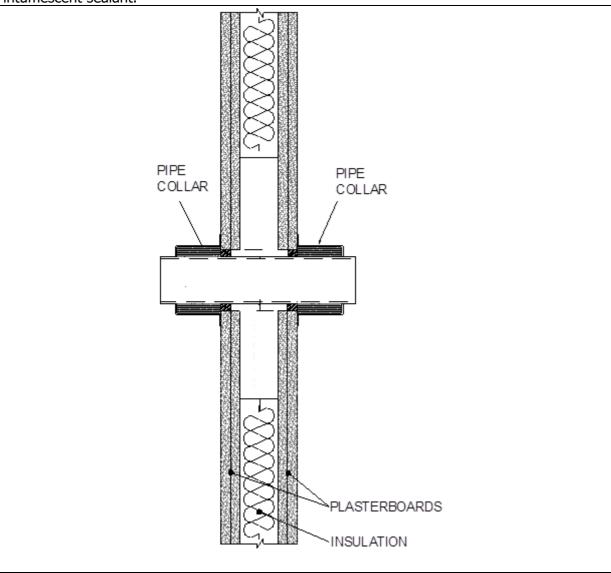

A.2.1.1 PVC-U pipes with PFC Corofil Intumescent pipe collar installed on both sides of flexible or rigid wall

PVC-U pipes according to EN 1452 with PFC Corofil Intumescent pipe collar.

Р	PFC Corofil Intumescent pipe collar, Face Fixed on Both Sides of Flexible or Rigid Wall (min 100 mm thick) PVC-U Pipes						
Penetration Specification	Collar Reference	Intumescent Material	Annulus Space (mm)	Collar Fixing	Classification		
PVC Pipe 32 mm ø 1.8 mm wall thickness	32 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 4 mm					
PVC Pipe 40 mm ø 1.8 mm wall thickness	40 mm PFC Corofil Intumescent pipe collar	(T)					
PVC Pipe 50 mm ø 1.8 mm wall thickness	50 mm PFC Corofil Intumescent pipe collar						
PVC Pipe 55 mm ø 2.3- 3.0 mm wall thickness	55 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 6 mm (T)	10	Fixed on both sides of the wall with a 6mm x 65mm long	EI 120 U/C		
PVC Pipe 63 mm ø 2.3- 3.0 mm wall thickness	63 mm PFC Corofil Intumescent pipe collar			Fisher HM 6x65 S, steel toggle anchor			
PVC Pipe 75 mm ø 3.1- 4.8 mm wall thickness	75 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 8 mm (T)					
PVC Pipe 82 mm ø 3.1- 4.8 mm wall thickness	82 mm PFC Corofil Intumescent pipe collar						
PVC Pipe 90 mm ø 4.2- 7.4 mm wall thickness	90 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 10 mm					
PVC Pipe 100 mm ø 4.2- 7.4 mm wall thickness	100 mm PFC Corofil Intumescent pipe collar	(T)					
PVC Pipe 110 mm ø 4.2- 7.4 mm wall thickness	110 mm PFC Corofil Intumescent pipe collar						
PVC Pipe 125 mm ø 6.0 mm wall thickness	125 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 12 mm (T)					
PVC Pipe 140 mm ø 6.1- 7.5 mm wall thickness	140 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 16 mm (T)					
PVC Pipe 160 mm ø 6.2- 9.5 mm wall thickness	160 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 18 mm (T)					

A.2.1.2 PP pipes with PFC Corofil Intumescent pipe collar installed on both sides of flexible or rigid wall


PP pipes according to EN 1451 with PFC Corofil Intumescent pipe collar.	PP p	ipes according	to EN 1451	with PFC Corofil	Intumescent pipe collar.
---	------	----------------	------------	------------------	--------------------------

P	PFC Corofil Intumescent pipe collar, Face Fixed on Both Sides of Flexible or Rigid Wall (min 100 mm thick) PP Pipes						
Penetration Specification	Collar Reference	Intumescent Material	Annulus Space (mm)	Collar Fixing	Classification		
PP Pipe 32 mm ø 2.9 mm wall thickness	32 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 4 mm					
PP Pipe 40 mm ø 2.9 mm wall thickness	40 mm PFC Corofil Intumescent pipe collar	(T)					
PP Pipe 50 mm ø 2.9 mm wall thickness	50 mm PFC Corofil Intumescent pipe collar						
PP Pipe 55 mm ø 2.9- 4.4 mm wall thickness	55 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 6 mm (T)	10	Fixed on both sides of the wall with a 6mm x 65mm long	EI 120 U/C		
PP Pipe 63 mm ø 2.9- 4.4 mm wall thickness	63 mm PFC Corofil Intumescent pipe collar		10	Fisher HM 6x65 S, steel toggle anchor	11 120 0/0		
PP Pipe 75 mm ø 2.8- 6.7 mm wall thickness	75 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 8 mm (T)					
PP Pipe 82 mm ø 2.8- 6.7 mm wall thickness	82 mm PFC Corofil Intumescent pipe collar						
PP Pipe 90 mm ø 2.7- 10.0 mm wall thickness	90 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 10 mm					
PP Pipe 100 mm ø 2.7- 10.0 mm wall thickness	100 mm PFC Corofil Intumescent pipe collar	(T)					
PP Pipe 110 mm ø 2.7- 10.0 mm wall thickness	110 mm PFC Corofil Intumescent pipe collar						
PP Pipe 125 mm ø 3.1 mm wall thickness	125 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 12 mm (T)					
PP Pipe 140 mm ø 3.5- 8.0 mm wall thickness	140 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 16 mm (T)					
PP Pipe 160 mm ø 4.0- 14.6 mm wall thickness	160 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 18 mm (T)					

A.2.1.3 PE pipes with PFC Corofil Intumescent pipe collar installed on both sides of **flexible or rigid wall** PE pipes according to EN ISO 15494 with PFC Corofil Intumescent pipe collar.

PF	PFC Corofil Intumescent pipe collar, Face Fixed on Both Sides of Flexible or Rigid Wall (min 100 mm thick) PE Pipes						
Penetration Specification	Collar Reference	Intumescent Material	Annulus Space (mm)	Collar Fixing	Classification		
PE Pipe 32 mm ø 2.9 mm wall thickness	32 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 4 mm					
PE Pipe 40 mm ø 2.9 mm wall thickness	40 mm PFC Corofil Intumescent pipe collar	(T)					
PE Pipe 50 mm ø 2.9 mm wall thickness	50 mm PFC Corofil Intumescent pipe collar						
PE Pipe 55 mm ø 2.9- 4.4 mm wall thickness	55 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 6 mm (T)	10	Fixed on both sides of the wall with a 6mm x 65mm long	EI 120 U/C		
PE Pipe 63 mm ø 2.9- 4.4 mm wall thickness	63 mm PFC Corofil Intumescent pipe collar		10	Fisher HM 6x65 S, steel toggle anchor	EI 120 0/C		
PE Pipe 75 mm ø 2.8- 6.7 mm wall thickness	75 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 8 mm (T)					
PE Pipe 82 mm ø 2.8- 6.7 mm wall thickness	82 mm PFC Corofil Intumescent pipe collar						
PE Pipe 90 mm ø 2.7- 10.0 mm wall thickness	90 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 10 mm					
PE Pipe 100 mm ø 2.7- 10.0 mm wall thickness	100 mm PFC Corofil Intumescent pipe collar	(T)					
PE Pipe 110 mm ø 2.7- 10.0 mm wall thickness	110 mm PFC Corofil Intumescent pipe collar						
PE Pipe 125 mm ø 3.1 mm wall thickness	125 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 12 mm (T)					
PE Pipe 140 mm ø 3.9- 5.8 mm wall thickness	140 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 16 mm (T)					
PE Pipe 160 mm ø 4.9- 9.5 mm wall thickness	160 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 18 mm (T)					

A.2.2 Penetration seal with PFC Corofil Intumescent pipe collar installed on both sides of rigid wall

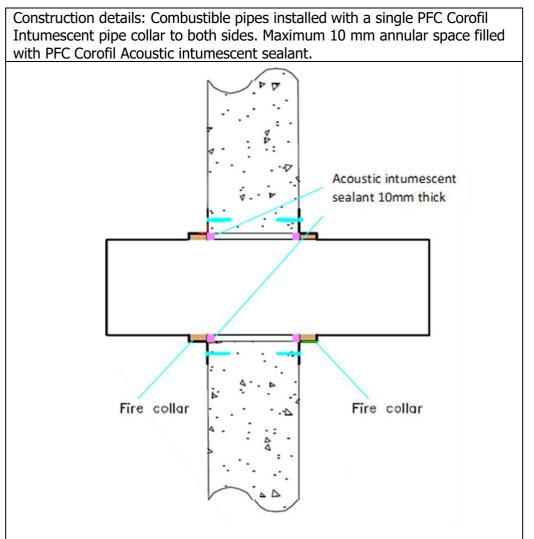

A.2.2.1 PP pipes with PFC Corofil Intumescent pipe collar installed on both sides of rigid wall

PP pipes according to EN 1451 with PFC Corofil Intumescent pipe collar.

PFC Corofil Intumescent pipe collar, Face Fixed on Both Sides of Rigid Wall (min 100 mm thick) PP Pipes							
Penetration Specification	Collar Reference	Intumescent Material	Annulus Space (mm)	Collar Fixing	Classificati on		
PP Pipe 110 mm ø 2.7 mm wall thickness	110 mm PFC Corofil Intumescent pipe collar	30 mm (W) x 10 mm (T)	10	Fixed on both faces of the wall with 3No. 40mm Fischer pins	EI 120 U/U		
PP Pipe 160 mm ø 4.0 mm wall thickness	160 mm PFC Corofil Intumescent pipe collar	40 mm (W) x 18 mm (T)		Fixed on both faces of the wall with 3No. Ø4 x 70mm wood screws and penny washers	EI 120 U/U		